


WALL PIPE FITTING

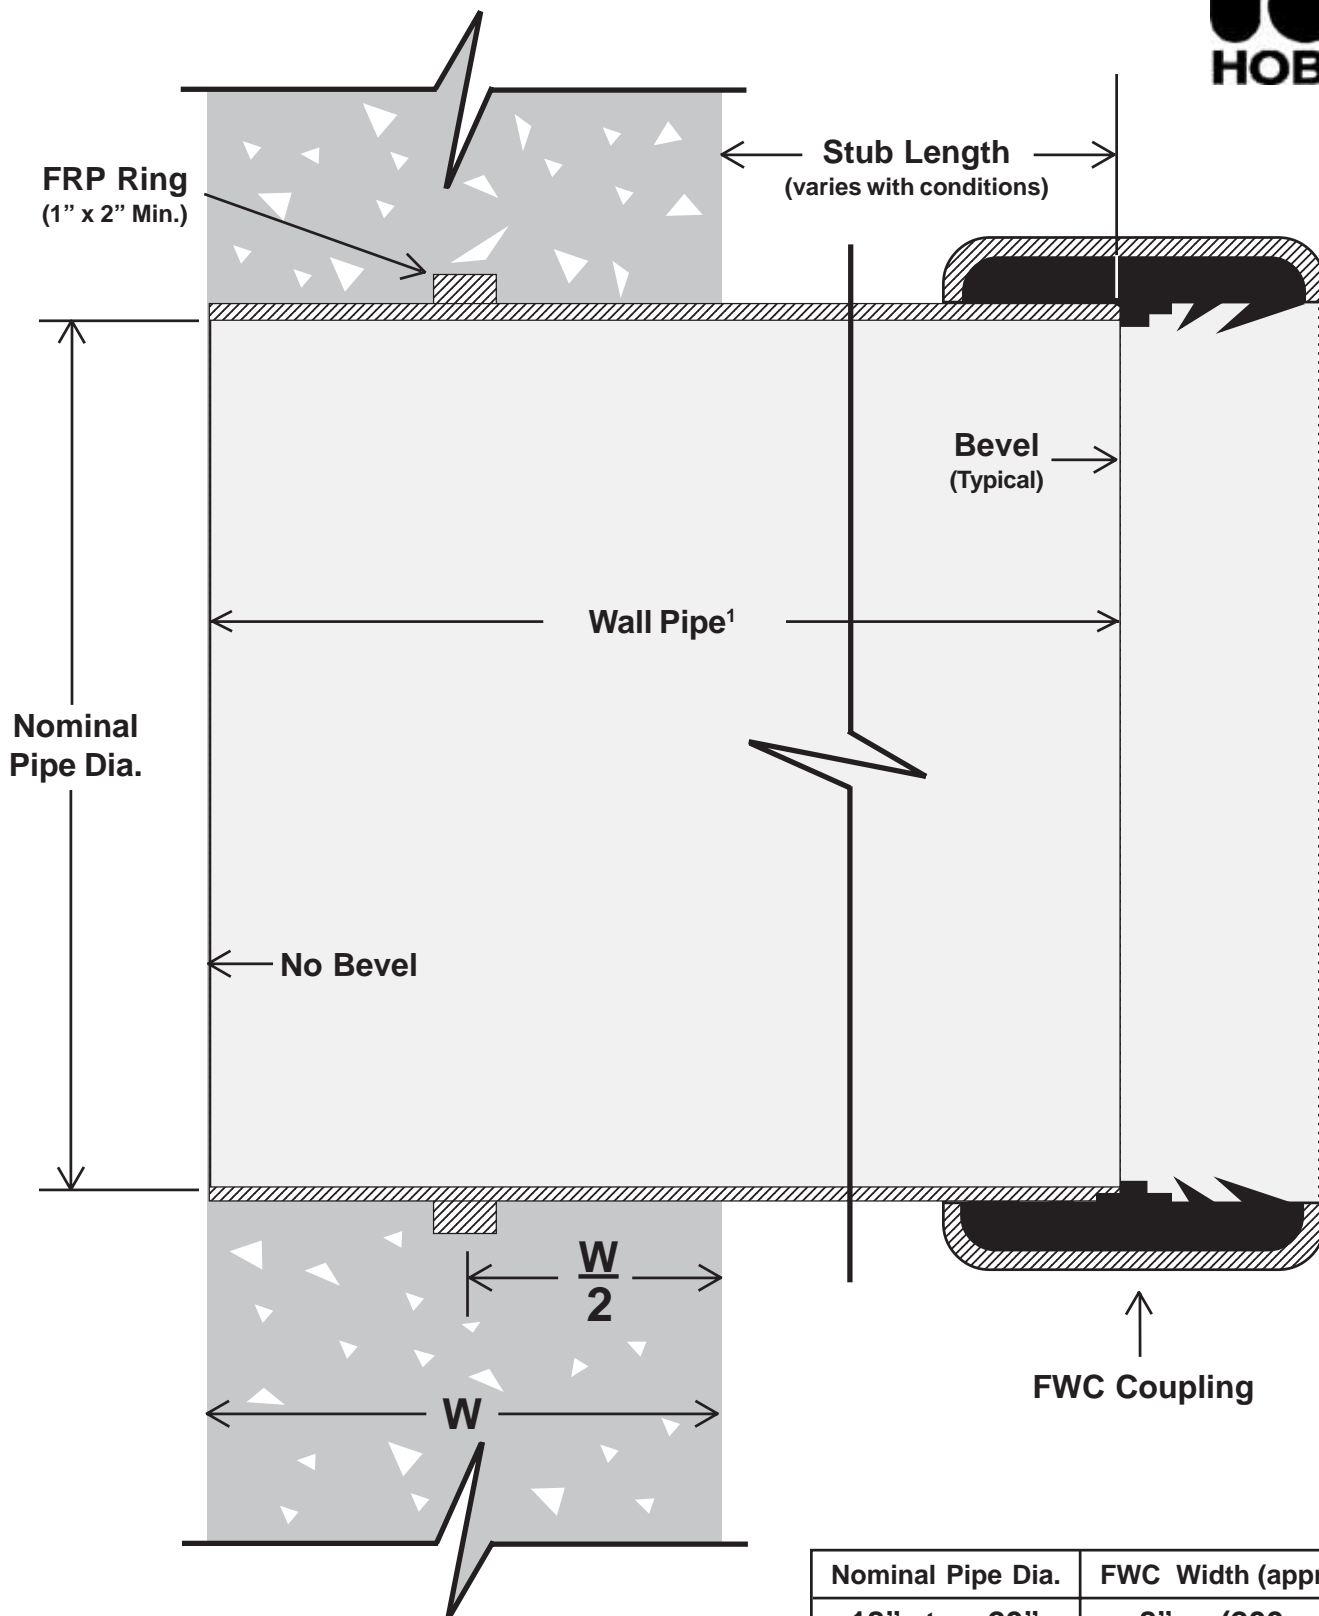

1. Minimum Wall Pipe length equal to structure thickness (W) plus Stub Length

Nominal Pipe Dia.	FWC Width (approx.)
18" to 20"	8" (200 mm)
24" to 54"	10" (250 mm)
57" to 110"	11 1/2" (290 mm)